


Getting Started with the M309 (Wireless) Ethernet Monitor

The M309 can operate in wireless Ethernet 802.11 b/g/n 2.4GHz only. Another wireless device, such as a smart phone, laptop, or tablet is required to get it on your wireless network.

M308/M309

Wiring Diagram (side view of enclosure)

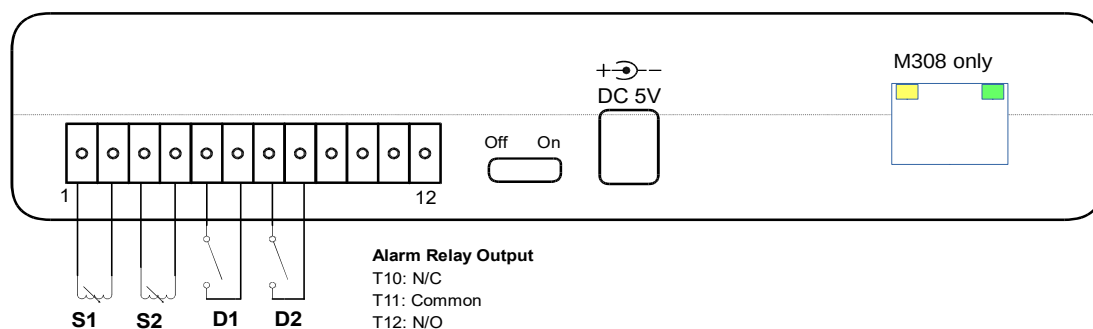


Installation

Install the batteries into the unit if necessary. Test by turning on without the AC adapter.

Mount the M309 in a location convenient to power and the environment to be monitored. Connect temperature and door sensors as needed (see diagrams below)

Sensor wiring examples:

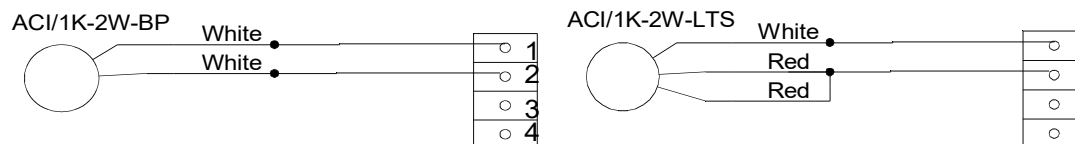

Download and install the Data Capture software

1. Download and install the latest version of Data Capture from <https://www.temperatureguard.com/software.html>
2. Wireless Setup Manual (M309 only) https://docs.wixstatic.com/ugd/390fef_acf6dde145c2404cbbf4b3af875cdb95.pdf

Battery Installation

Remove the four cover screws and install batteries if not already installed. Positive to the left. Batteries should be replaced about every 5 years. Use AA NiMH rechargeable batteries only.

Reset to DHCP (M309 only)

Use the soft AP to switch back to DHCP mode.

https://docs.wixstatic.com/ugd/390fef_acf6dde145c2404cbbf4b3af875cdb95.pdf

See page 3. Enable the DHCP Client option.

